PROPER NEEDLE INSERTION INTO QUALITRU® SEPTUM

QUALITRU SAMPLING SYSTEMS

PN: 110011
TruStream7
Septum

PN: 110021
TruStream7
Septum
(High Temp)

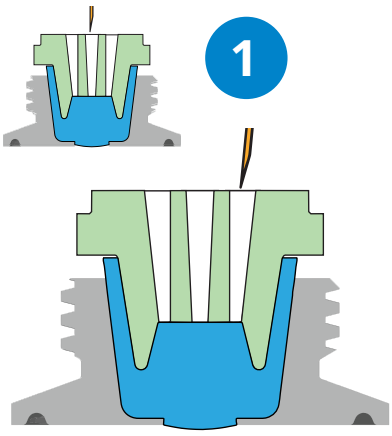

Line the hypodermic needle up with the channel you plan to use.

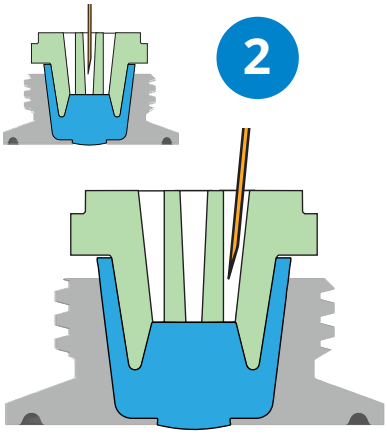

Face the bevel of the needle outward, or toward the outer ring.

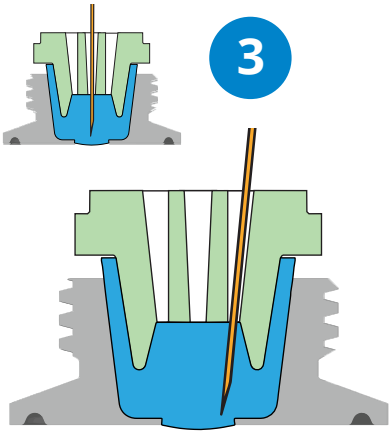

Slowly push the hypodermic needle until you meet resistance.

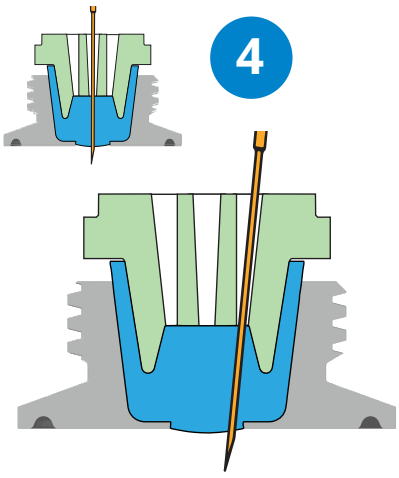

Gently continue through the rubber until you can push no further.

Do not spin or twist on the way through, as you could core the rubber.

Needle Insertion Training Guide

Sales@QualiTru.com | 651-501-2337 | QualiTru.com

MKTG-800-REVB-02212023

INSERCIÓN CORRECTA DE UNA AGUJA EN EL SEPTO QUALITRU®

QUALITRU SAMPLING SYSTEMS

PN: 110011
Septo
TruStream7

PN: 110021
Septo
TruStream7
(Alta temperatura)

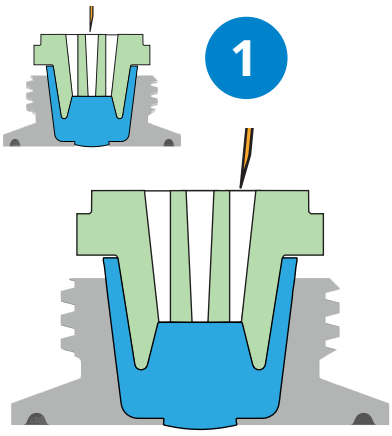

Alinee la aguja hipodérmica con el canal que planea usar.

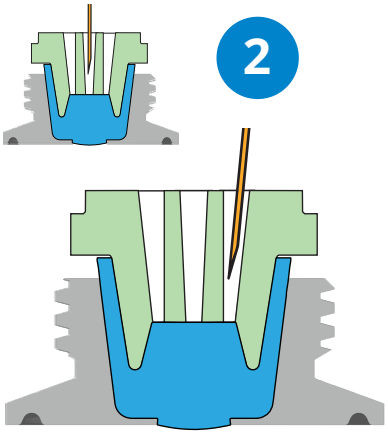

Coloque el bisel de la aguja en dirección hacia afuera o hacia el anillo exterior.

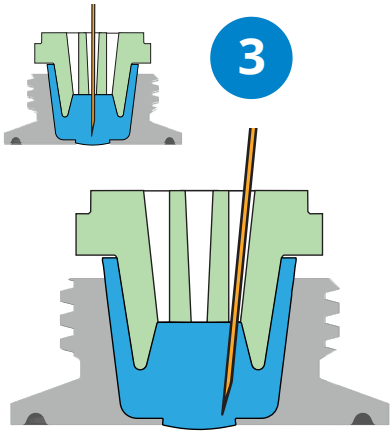

Empuje lentamente la aguja hipodérmica hasta encontrar resistencia.

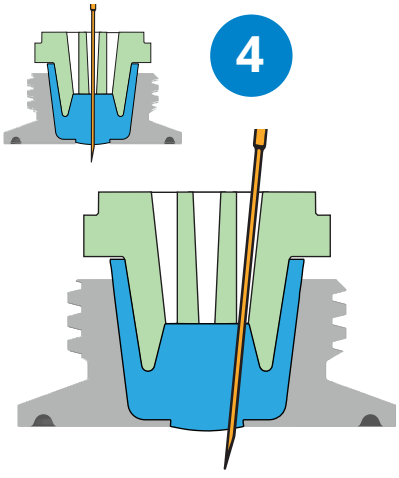

Suavemente, continúe empujando a través de la goma hasta que ya no pueda hacerlo.

No gire ni haga un movimiento de rotación a medida que atraviesa la goma, ya que podría desprenderla.

Guía de entrenamiento para la inserción de la aguja

Sales@QualiTru.com | 651-501-2337 | QualiTru.com

MKTG-800SP-REVB-02212023